



RKDT-WM/WS Installation Instructions


SWITCHPLATE INSTALLATION DIAGRAM

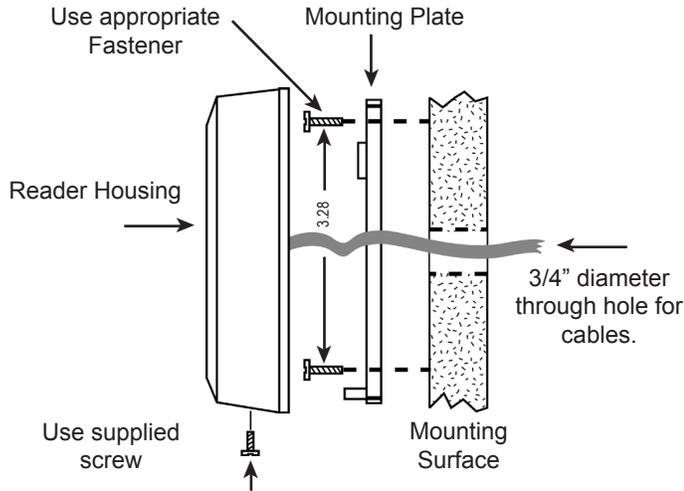


1. If mounting the unit outdoors, especially on a rough surface like masonry, we recommend that you seal the reader with silicone caulking.
2. Drill holes as needed per installation diagram shown to the left or install a single gang j-box.
3. Run field wiring to reader location and feed into j-box or through cable hole.
4. Attach the mounting plate to the mounting surface or j-box with the appropriate fasteners.
5. Splice the connector pigtail to field wiring. Insert the connector into the back of the reader.
6. Attach the housing to the mounting plate by inserting the two tabs inside the top of the housing into the two slots at the top of the mounting plate.
7. Secure by installing supplied screw into the hole at the bottom of the reader.



MULLION INSTALLATION DIAGRAM

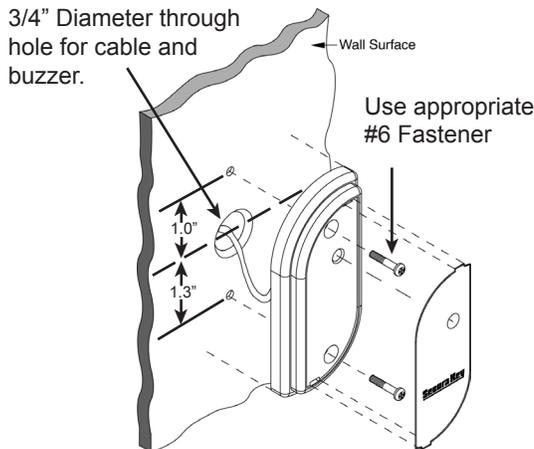

1. If mounting the unit outdoors, especially on a rough surface like masonry, we recommend that you seal the reader with silicone caulking.
2. Drill a hole for the field wiring. Remove label insert from reader. Using the reader as a template, mark the location of the two mounting holes. Drill two 1/8" pilot holes for the mounting screws.
3. Run field wiring to reader location and feed through cable hole.
4. Splice the reader cable to field wiring.
5. Attach the reader to the surface using the two machine screws provided. These may be replaced with tamper proof screws (customer supplied).
6. Snap the label insert into front of reader to cover screws.

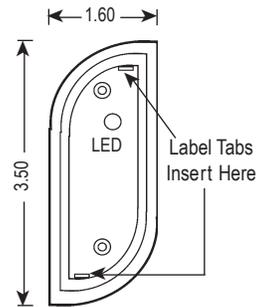

WIRING CONNECTIONS

WIRE COLOR	RKDT-WM	RKDT-WS
RED	5-14 VDC +	5-14 VDC +
BLACK	GROUND —	GROUND —
YELLOW	BUZZER INPUT (1)	BUZZER INPUT (1)
BLUE	HOLD	HOLD
ORANGE	GREEN LED INPUT (1)	GREEN LED INPUT (1)
BROWN	RED LED INPUT (1)	RED LED INPUT (1)
GREEN	WIEGAND DATA-0	WIEGAND DATA-0
WHITE	WIEGAND DATA-1	WIEGAND DATA-1
VIOLET	NOT USED	NOT USED
GRAY	NOT USED	NOT USED
(1) Connect to GROUND to activate		

PARTS SUPPLIED:

Reader

Installation Instructions all Models
Mounting Plate (RKDT-WS only)
2, #6 Mounting Screws
1, 4x40 Screw (RKDT-WS only)
1, Security Screw (RKDT-WS only)
Snap-In Labels (RKDT-WM only)

ACCESSORIES (NOT INCLUDED):

RK-BB: Back Box/Spacer (RKDT-WS only)

SPECIFICATIONS:

POWER REQUIREMENTS

5-14 VDC, 150 mA Max.

CONTROL INPUTS

Red LED, Green LED and Buzzer for online systems.

WIEGAND OUTPUT

Any Wiegand Format up to 40 bits

Maximum Distance: 500 ft. - 5 or 6 conductor 20 gauge shielded cable

ENVIRONMENT

Reader, Key Tags and Cards

Ambient Temperature -40° to +70°C (-40° to +158°F)

Humidity 0 to 95% (non-condensing)

**INSTRUCTION TO THE USER
FCC ID: NNHDTR1**

"This device complies with Part 15 of the FCC rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation."

This equipment has been certified to comply with the limits for a class B computing device, pursuant to FCC Rules. In order to maintain compliance with FCC regulations, shielded cables must be used with this equipment. Operation with non-approved equipment or unshielded cables is likely to result in interference to radio and TV reception. The user is cautioned that changes and modifications made to the equipment without the approval of the manufacturer could void the user's authority to operate this equipment.

Secura Key
A Division of SOUNDCRAFT Inc.

20301 Nordhoff Street, Chatsworth, CA 91311
PHONE (818) 882-0020 • FAX (818) 882-7052
TOLL-FREE (800) 891-0020
Website: www.securakey.com
E-mail: mail@securakey.com